

	1-2	2-3	3-4	4-5	5-6	6-7	7-8	8-9	9-10	10-11	11-12	12-13	13-14	14-15	15-16	16-17	17-18	18-19	19-20	20-21	21-22	22-23	23-24
B1F																							
1F		300W				300W			300W										300W			300W	
2F		300W			300W	300W	150V	300W×2、 200V		300W	300W	300W		300W								300W	
3F						300W			300W	300W	300W			300W								100V×2	
4F																							

	24-25	25-26	26-27	27-28	a-b	b-c	c-d																
B1F		300W、 200V×2	300W	300W		300W	100V×2																
1F			300W		200V×2	300W	300W																
2F																							
3F			300W		200W																		
4F																							

	A-B	B-C	C-D	D-E	E-F	F-G	G-H	H-I	I-J	J-K	K-L	L-M	M-N	N-O	O-P	P-Q	Q-R						
B1F																							
1F																							
2F																							
3F																							
4F																							


	イ-ロ	ロ-ハ	ハ-ニ	ニ-ホ	ホ-ヘ	ヘ-ト	ト-チ	チ-リ	リ-ヌ	ヌ-ル	ル-ヲ	ヲ-ワ											
B1F																							
1F																							
2F																							
3F																							
4F																							

集計

300□のウェザーカバー(300W):28個
200□のウェザーカバー(200W):3個
200φベントキヤップ(200V):2個
150φベントキヤップ(150V):1個
100φベントキヤップ(100V):4個
200φスパイラルダクト貫通:1か所

注意

その他配管貫通、窓設置型エアコンは未集計

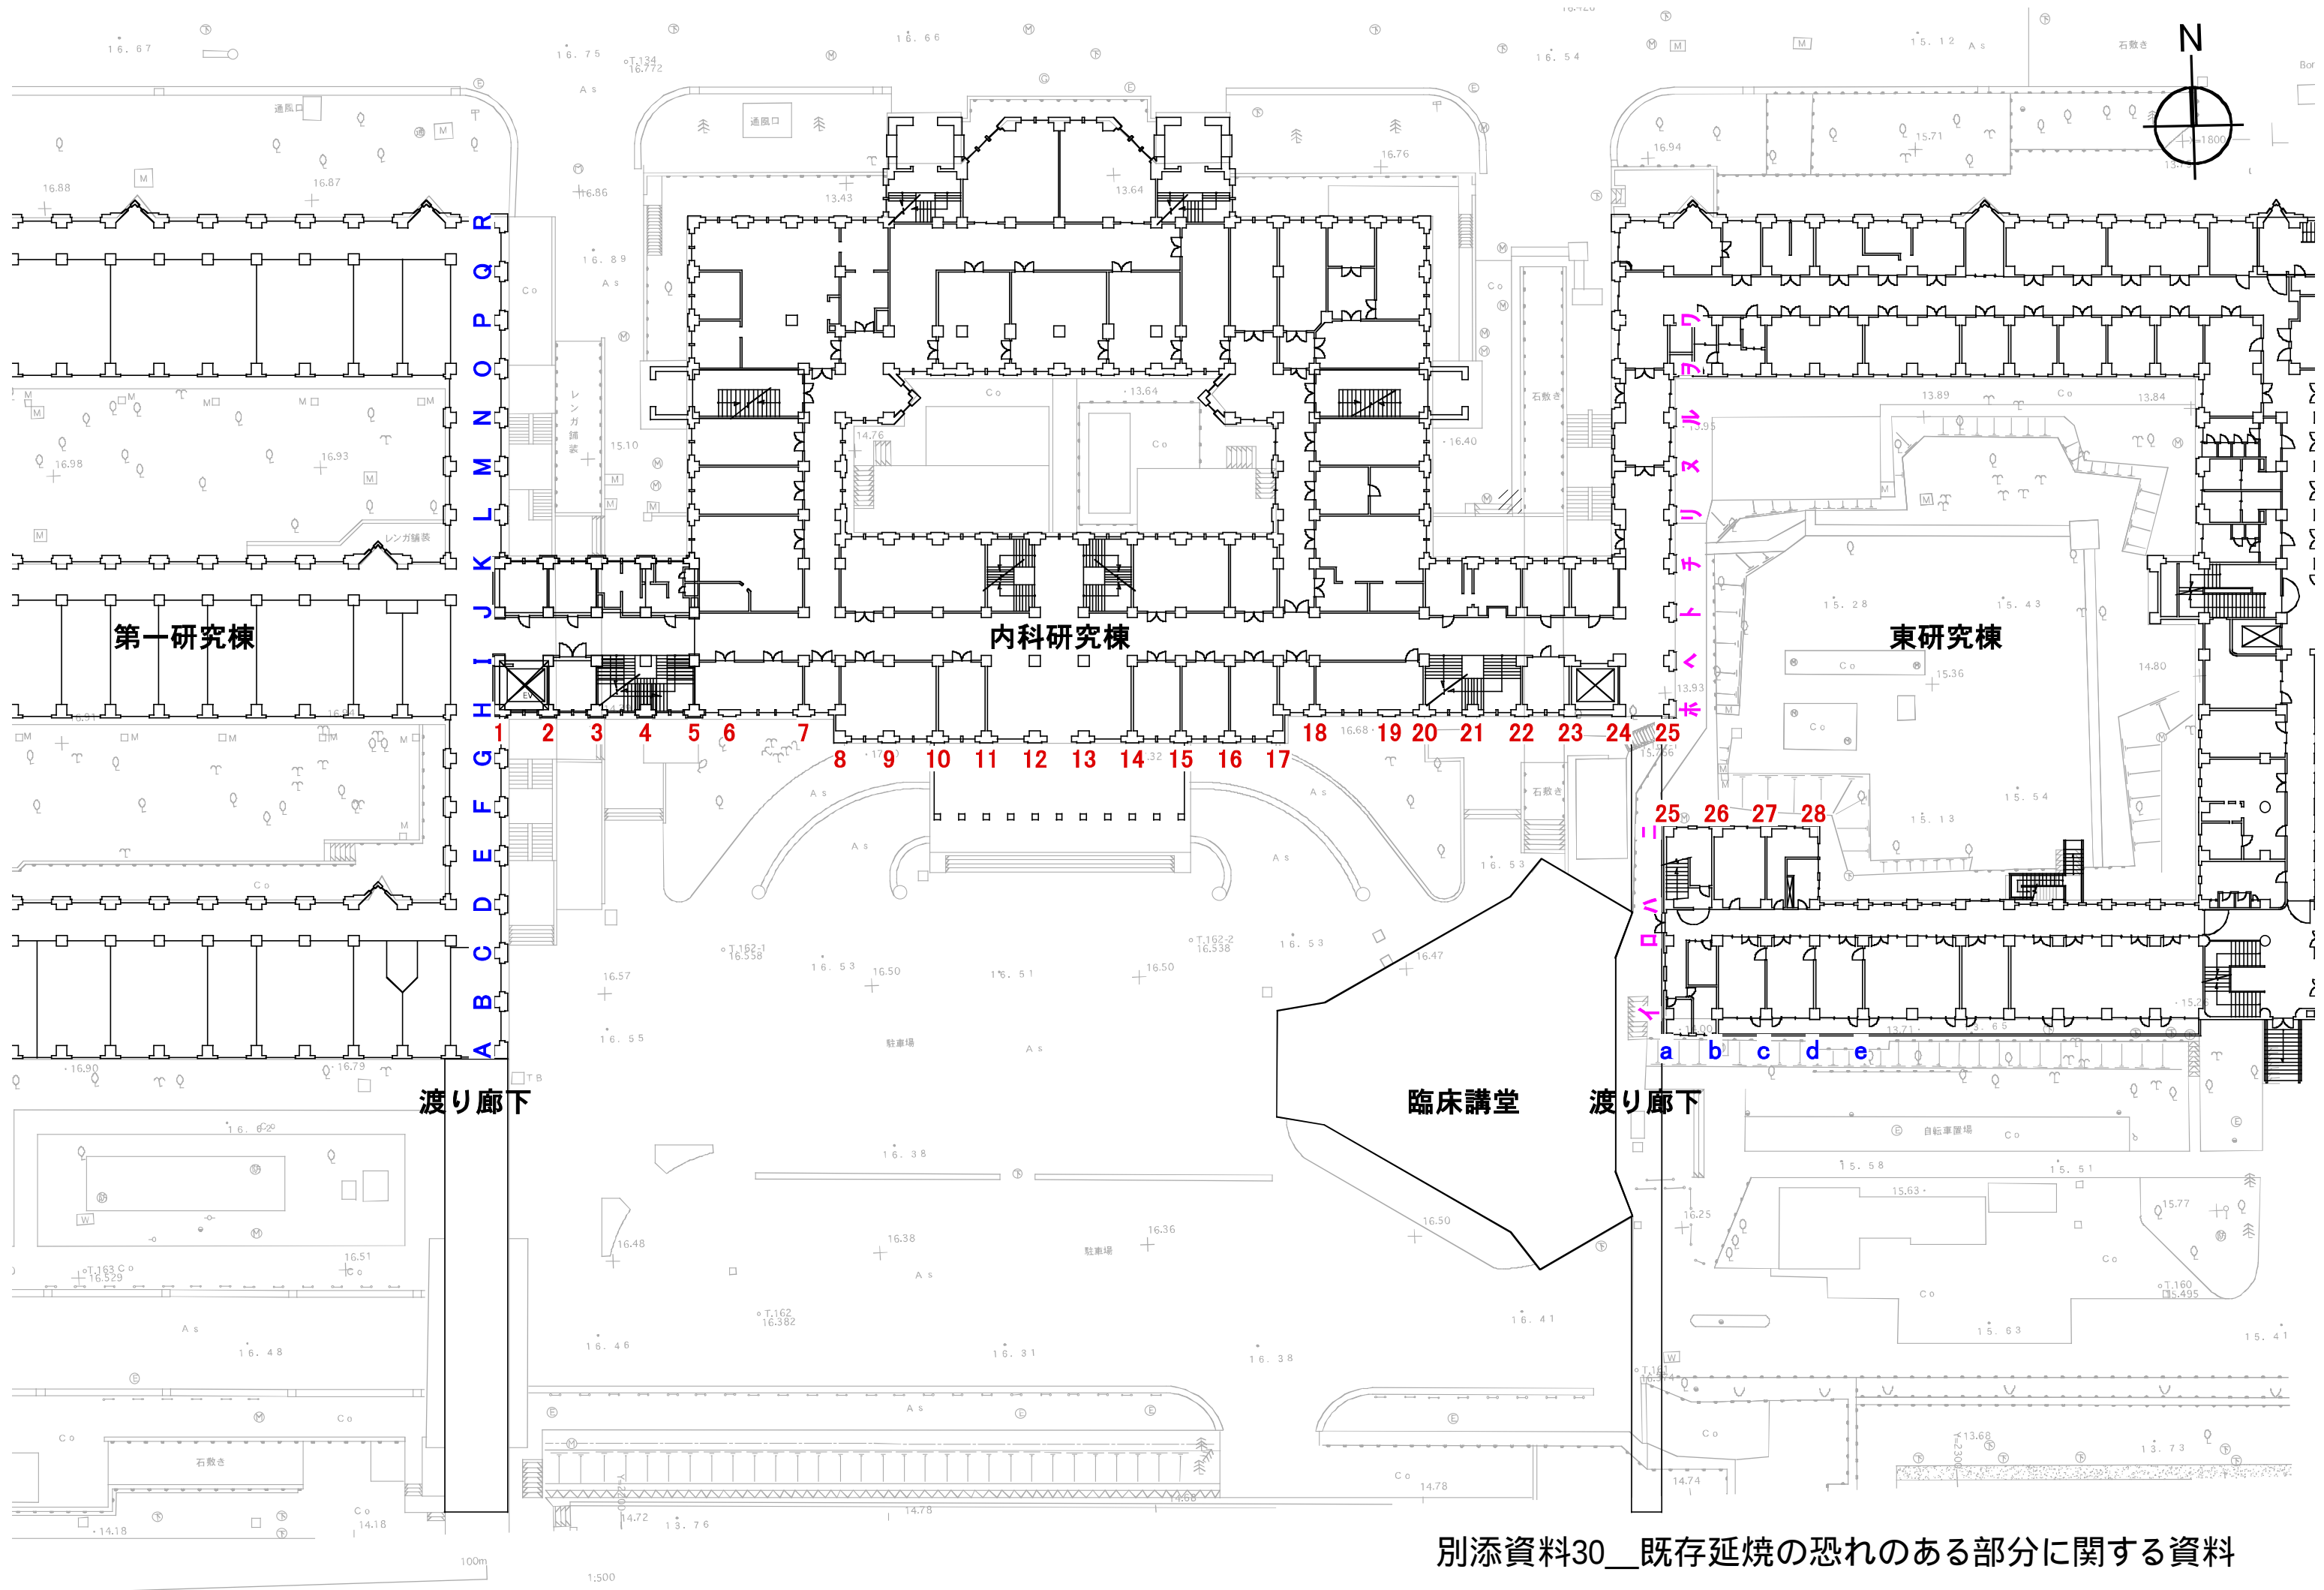

別添資料30__既存延焼の恐れのある部分に関する資料